


Do not touch the NX bus connector

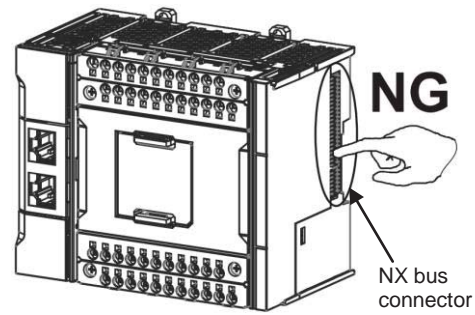

9609418-8B

OMRON SYSMAC NX1P2 and NX1W series INSTRUCTION SHEET

© OMRON Corporation 2016 All Rights Reserved.

Precautions for Compliance with UL/CSA Standards and EU Directives

Notice to Users of SYSMAC NX1P2 and NX1W series in USA, Canada and Europe.

This manual must be consulted in all cases in order to find out the nature of the potential HAZARDS and any actions which have to be taken to avoid them.

If the equipment is used in a manner not specified by the manufacturer, the protection by the equipment may be impaired.

This product is defined as an in-panel device and must be installed within a control panel.

Environment

Power Supply Voltage:	DC24V (85% to 120%)
Surrounding Air Temperature:	0 to 55 °C (Avoid freezing or condensation)
Surrounding Air Humidity:	10% to 95%RH
Altitude:	2000m max.
Installation Environment:	Pollution Degree2
Temp. code	T4A
Indoor Use Only	

24-V DC power source

The external power supplies must be DC power supplies that satisfy the SELV requirements.

Power consumption : 24V DC, 0.86A
NX UNIT POWER OUTPUT :10W, 5.8V

I/O specifications

NX1P2 series.

INPUT specification

NX1P2-9024DT□	24V DC, 5.8mA 14 POINTS
NX1P2-1□40DT□	24V DC, 5.8mA 16 POINTS/ 5.3mA 8 POINTS

OUTPUT specification

NX1P2-9024DT	12-24V DC(GEN.)(TUN.)(P.D.) 0.3A/P, 2.4A/C, 2.4A/U 10POINTS, NPN
NX1P2-9024DT1	24V DC(GEN.)(TUN.)(P.D.) 0.3A/P, 2.4A/C, 2.4A/U 10POINTS, PNP
NX1P2-1□40DT	12-24V DC(GEN.)(TUN.)(P.D.) 0.3A/P, 1.8A/C, 3.6A/U 16POINTS, NPN
NX1P2-1□40DT1	24V DC(GEN.)(TUN.)(P.D.) 0.3A/P, 1.8A/C, 3.6A/U 16POINTS, PNP

NX1W series.


NX1W-CIF01	-
NX1W-CIF11	-
NX1W-CIF12	-
NX1W-ADB21	Input: 0 to 10 V, 0 to 20 mA, 2 points
NX1W-DAB21V	Output: 0 to 10 V, 2 points
NX1W-MAB221	Input: 0 to 10 V, 0 to 20 mA, 2 points, Output: 0 to 10 V, 2 points

Cable for I/O terminal

Please select the cable by which rated temperature is 80 °C or above.

Directions for installation

Vertical only.

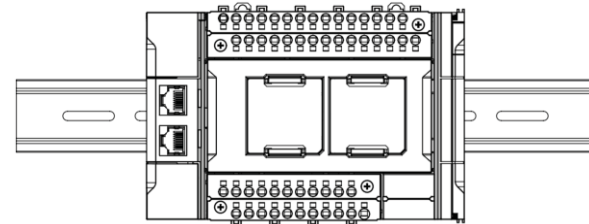

Cleaning

Do not use paint thinner or similar chemical to clean with. Use a dry cloth.

Enclosure type

You must use this product in a control board.

Enclosure type: Type 1 or more.

Marking

⚡: Functional Earth Terminal

Battery (optional)

Mount the CJ1W-BAT01 Battery (sold separately) to an NX1P2 series CPU unit if clock data need to be retained after a power interruption.


➤ Installing the battery.

1. Remove the battery cover on CPU unit and carefully draw out the Battery. Connect the new Battery, place it into the compartment, and close the cover.

➤ Replacing the battery.

1. Turn OFF the power supply to the NX1P2 series CPU unit. If the CPU unit has not been ON, turn it ON for at least 5 minutes and then turn it OFF.

2. Remove the battery cover on CPU unit and carefully draw out the Battery. Remove the Battery connector. Connect the new Battery, place it into the compartment, and close the cover.

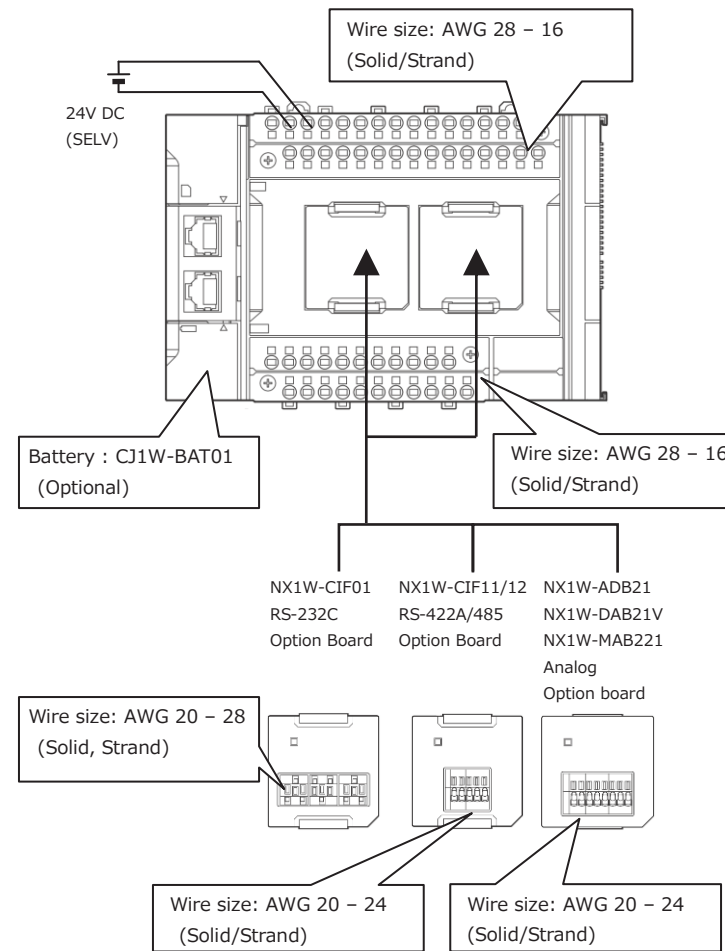

Compliance to UL Standards and CSA Standards

Compliance with Class I Division 2 Hazardous Location:

Input and output wiring must be in accordance with Class I Div.2 wiring methods and in accordance with the authority having jurisdiction.

- This equipment is suitable for use in Class I, Division.2, Groups A, B, C, D or Non-Hazardous Locations Only.
- WARNING: Explosion Hazard – Do not Disconnect Equipment Unless Power Has Been Switched off or the Area Is Known to Be Non-Hazardous
- This device is open-type and is required to be installed in an enclosure suitable for the environment and can only be accessed with the use of a tool or key

- CET APPAREILLAGE EST UTILISABLE DANS LES EMPLACEMENTS DE CLASS I, DIVISION 2, GROUPES A, B, C ET D, OU DANS LES EMPLACEMENTS NON DANGEREUX SEULEMENT.
- AVERTISSEMENT-ISQUE D'EXPLOSION-AVANT DE DECONNECTER L'EQUIPEMENT. COUPER LE COURANT OU S'ASSURER QUE L'EMPLACEMENT EST DESIGNE NON DANGEREUX.
- CE DISPOSITIF EST DE TYPE OUVERT ET DOIT ETRE INSTALLE DANS UN COFFRET ADAPTE A L'ENVIRONNEMENT ET AUQUEL ON NE POURRA ACCEDER UNIQUEMENT AU MOYEN D'UNOUTIL OU D'UNE CLE.

Applicable wire size for Unit power source and I/O terminal

Type	Wire size	Strip length	Conductor surface
Solid/Strand	AWG 28-16	9mm	Plated
Solid/Strand	AWG 14	11mm	Plated

- Do not use ferrule terminals. Insert the strand or solid wire directly into the holes on the terminal block.
- Do not insert more than one wire in one terminal.
- Please select wire sizes suitable for rated current.

Wire size	Current (MAX)
AWG 28 - 24	2A
AWG 22	3A
AWG 20 - 16	5A

Conformance to EU Directives

This product is EMC-compliant when assembled in PLC system or Machine Automation Controller. To ensure the EC Directive conformance of customer's machinery or equipment in which the product is incorporated, be sure to observe the following precautions.

- This product is defined as an in-panel device and must be installed within a control panel.
- Reinforced insulation or double insulation must be used for the DC power supply connected to the DC power supply unit, communication unit, and I/O unit.
- This product complies with the common emission standard (EN61131-2) with regard to EMI. For the radiated emission requirement (10-m regulations), in particular, please note that the actual emission varies depending on the configuration of the control panel to be used, the connected devices, and wiring methods. Therefore, the customer must confirm the EC Directive conformance of the overall machinery or equipment by themselves, even if this EC conforming product is used.

This is a class A product. In residential areas it may cause radio interference, in which case the user maybe required to take adequate measures to reduce interference.

For KC standard only

A급 기기 (업무용 방송통신기자재)
이 기기는 업무용(A급) 전자파적합기기로서 판매자 또는 사용자는 이 점을 주의하시기 바라며,가정외의 지역에서 사용하는 것을 목적으로 합니다.

OMRON

OMRON Corporation (Manufacturer)
Shiokoji Horikawa, Shimogyo-ku,
Kyoto, 600-8530 Japan
Tel: (81)75-344-7109
Fax: (81)75-344-7149

Regional Headquarters
OMRON EUROPE B.V. (Importer in EU)
Wegalaan 67-69,
NL-2132 JD Hoofddorp
The Netherlands
Tel: (31)2356-81-300
Fax: (31)2356-81-388



OMRON ELECTRONICS LLC
2895 Greenspoint Parkway,
Suite 200 Hoffman Estates,
IL 60169 U.S.A
Tel: (1)847-843-7900
Fax: (1)847-843-7787

Note: Specifications subject to change without notice.
Printed in China

OMRON ASIA PACIFIC PTE. LTD.
No 483A Alexandra Road # 05-05/08
(Lobby 2), Alexandra Technopark,
Singapore 119967
Tel: (65)6835-3011
Fax: (65)6835-2711


OMRON (CHINA) CO., LTD.
Room 2211, Bank of
China Tower,
200 Yin Cheng Zhong Road,
PuDong New Area, Shanghai,
200120 China
Tel: (86)21-5037-2222
Fax: (86)21-5037-2200

● I/O Wiring Diagram

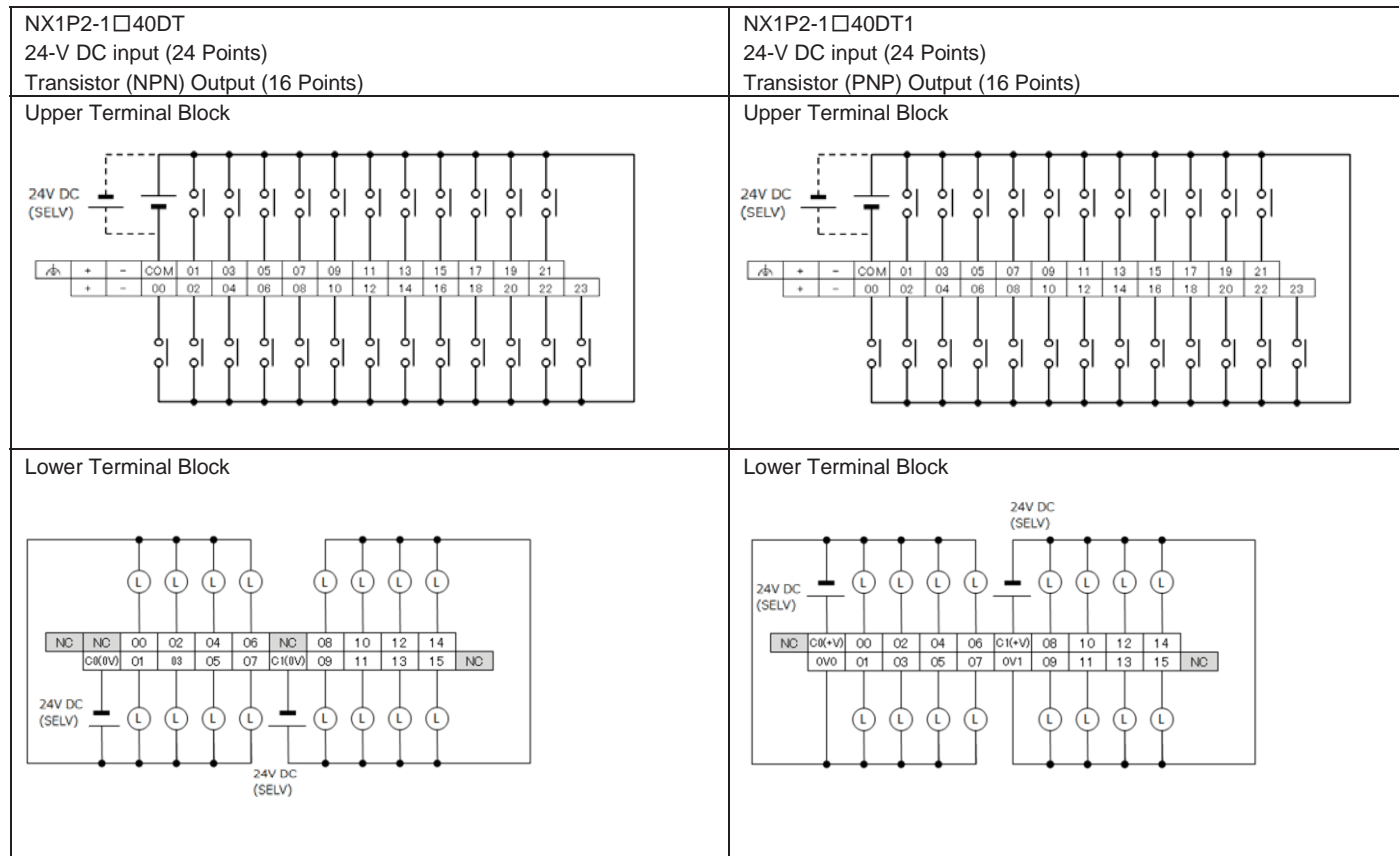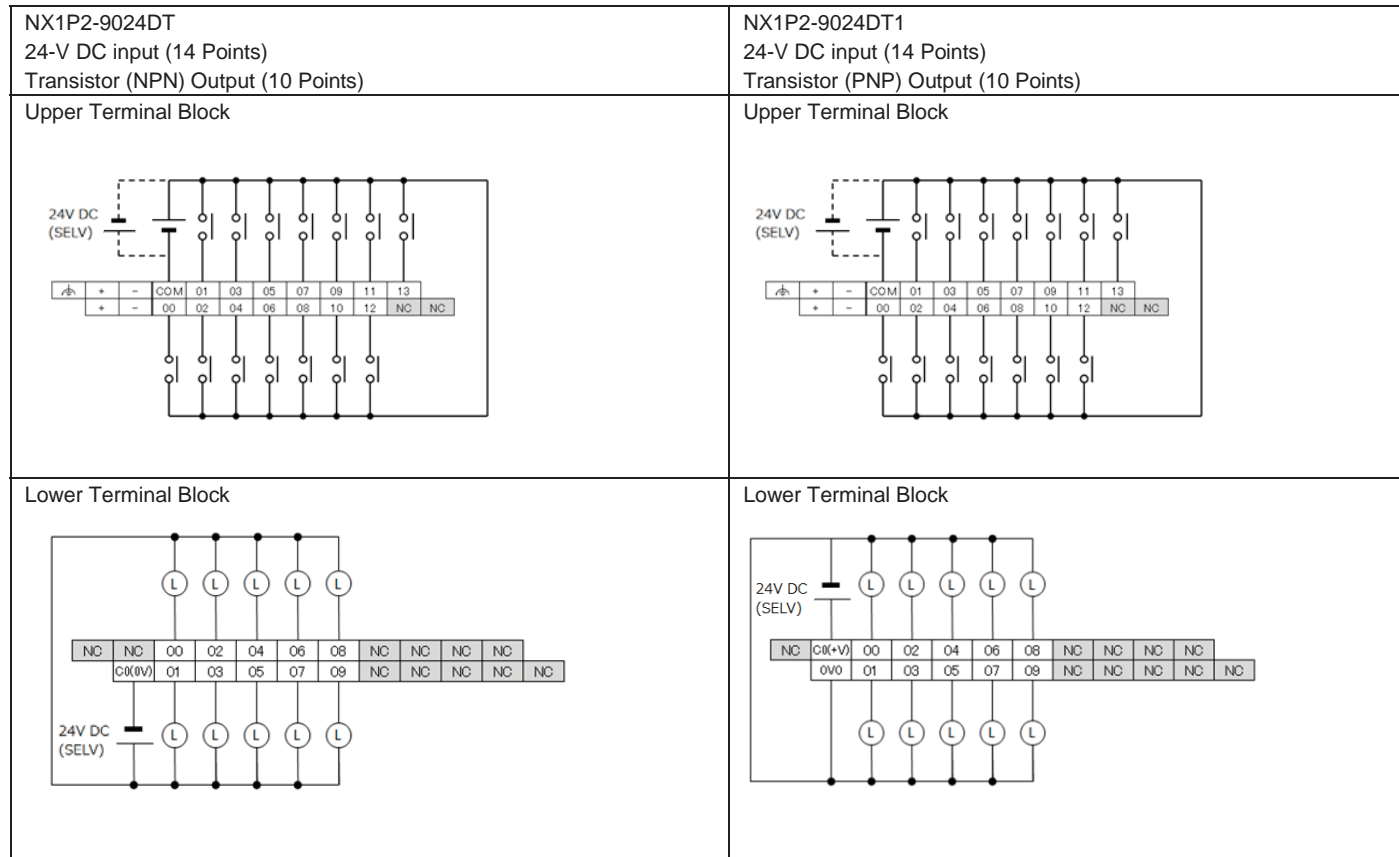

*Note : The wiring of the Functional Earth Terminal

Push AWG14 solid wire into functional earth area, and sway it both A and B side slightly until top of wire goes into fixed hole

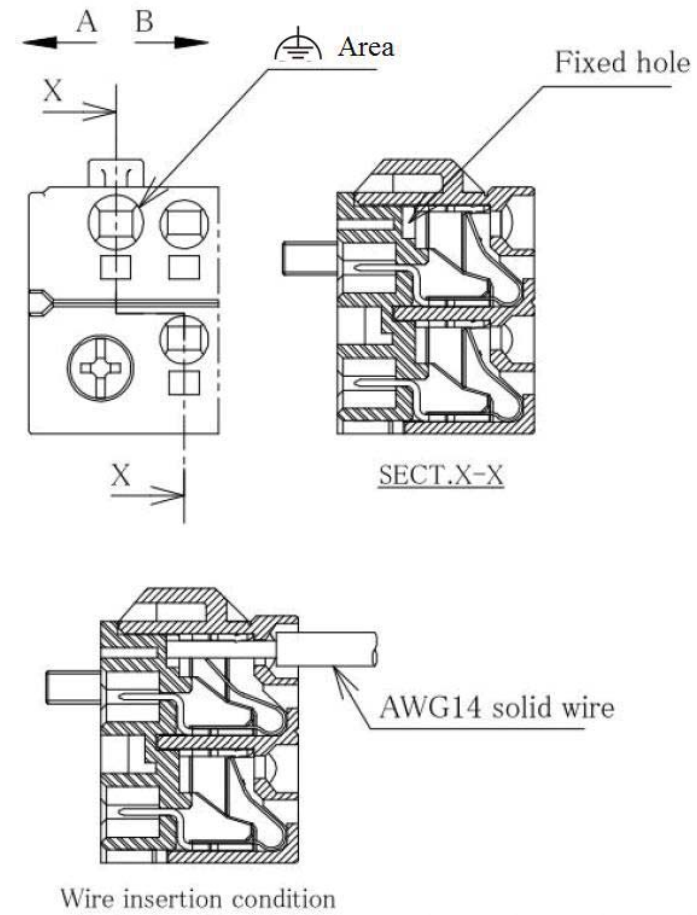

● Option board

